


Chloride Trend at MW-3S. The most conservative water quality guideline for chloride in groundwater is 250 mg/L.¹

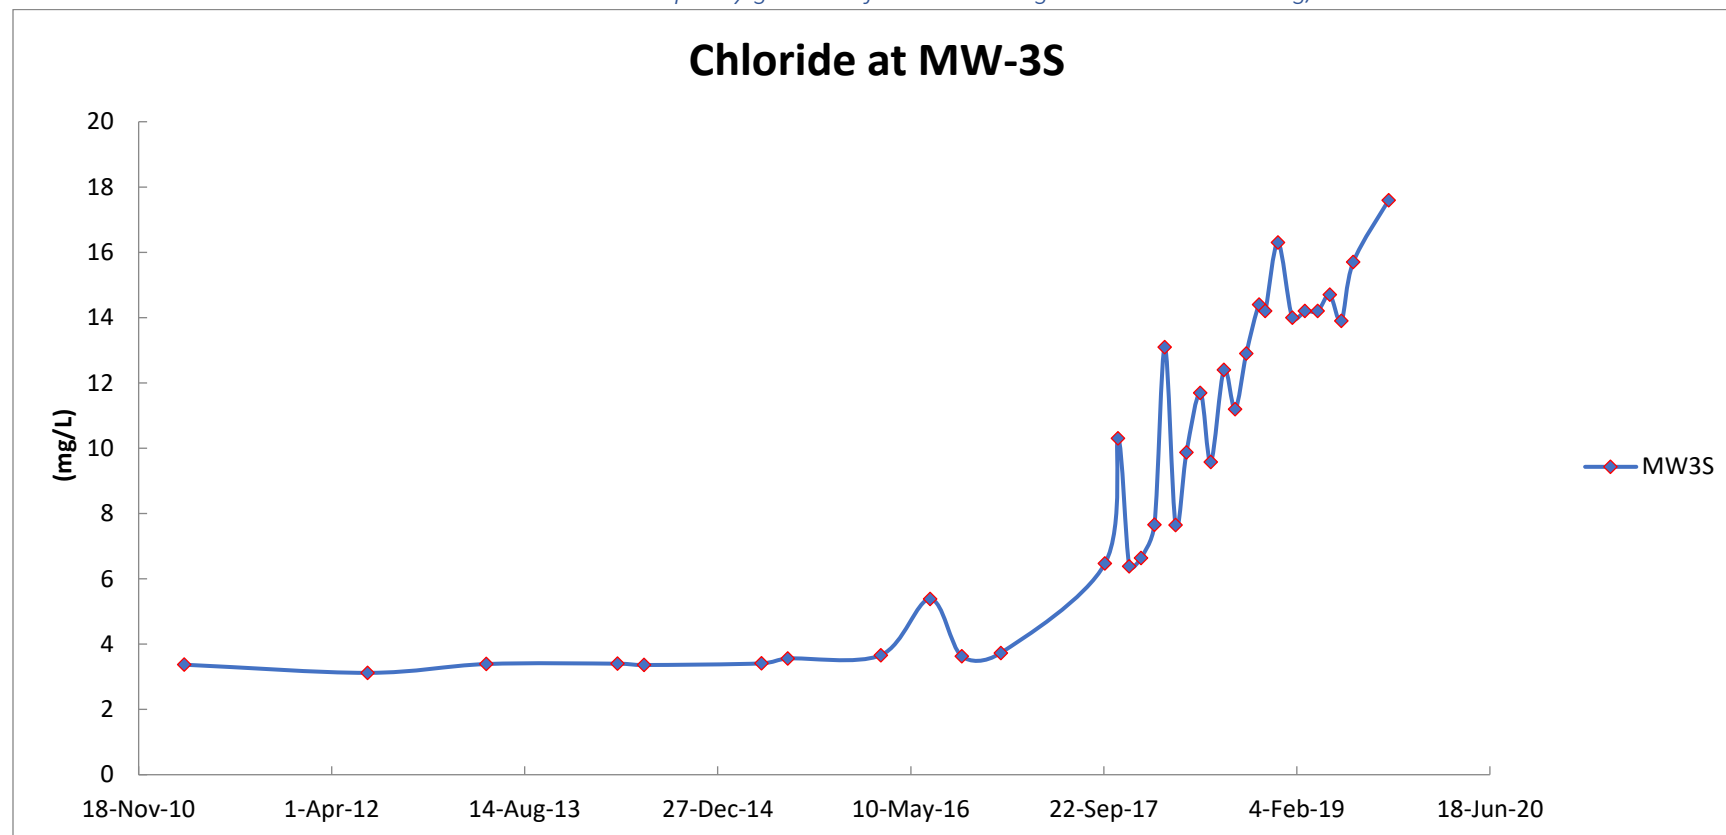

¹ [Contaminated Sites Regulation, Schedule 3.2 Generic Numerical Water Standards.](#)