

## STRINGER IDENTIFICATION

DEPTH OF STRINGER IN mm

LENGTH OF STRINGER IN METERS-

EXTERIOR OR INTERIOR STRINGER-

RUNNING SURFACE

-65 DEEP RECESS (SEE NOTE No. 14)

STRINGER MK. 600/12/E 13 615 kg 13 140 kg STRINGER MK. 600/12/I

A LIFTING DEVICE RECESS DETAIL

SCALE 1:5

ESTIMATED MASS

**NOTES** 

DESIGN SPECIFICATIONS:

DESIGN LOAD:

CAN/CSA-S6-06. BC MoT SUPPLEMENT TO S6-06.

DESIGN LOAD:

LIVE LOAD: CL-625 & BCL-625

DEAD LOAD: DESIGNED FOR 100mm CONCRETE OVERLAY.

STRINGERS SHALL BE MANUFACTURED IN ACCORDANCE WITH THE M.O.T.

STANDARD SPECIFICATION 415: MANUFACTURE OF PRECAST AND PRESTRESSED

STANDARD SPECIFICATION 415: MANUFACTURE OF PRECAST AND PRESTRESSED CONCRETE MEMBERS.

4. PRESTRESSING STRANDS SHALL BE 130 (7 WIRE) UNCOATED LOW RELAXATION STRANDS, C.S.A. G279M-1982, 1862 MPG GRADE OR EQUIVALENT. MINIMUM ULTIMATE TENSILE STRENGTH = 184 km/STRAND. STRAND TENSION IMMEDIATELY BEFORE RELEASE = 136.2 km/STRAND.

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT TIME OF RELEASE OF STRANDS = 27MPa, AT 28 DAYS = 35MPa. REINFORCING STEEL SHALL CONFORM TO C.S.A. G30.18M GRADE 400R. REINFORCING STEEL SHALL HAVE 35mm MINIMUM COVER UNLESS OTHERWISE

ALL REINFORCING MARKED "ME" IS EPOXY COATED.

LAP OF BARS FOR SPLICES TO BE AS FOLLOWS UNLESS NOTED OTHERWISE:

10M BARS — 450

10ME BARS — 600


SPLICES TO BE STAGGERED.


SOUTOM EDGES OF STRINGERS SHALL BE CHAMFERED 20mm.
LIFTING DEVICES SATISFACTORY TO THE ENGINEER SHALL BE PROVIDED
OVER THE BEARINGS. ONLY VERTICAL LIFTS WILL BE PERMITTED. CARE
SHALL BE TAKEN TO PREVENT SUDDEN IMPACT LOADS ON THE STRINGERS.

12. ENDS OF PRESTRESSING STRANDS SHALL BE TREATED AS FOLLOWS:
EMBEDDED IN CONCRETE: PAINTED WITH A GANVANIZING AGENT.
EXPOSED: A MINIMUM 3mm COAT OF THIXOTROPIC EPOXY AS SHOWN.
MANUFACTURES INSTRUCTIONS TO BE STRICTLY ADHERED TO.

TOP OF BOXES SHALL HAVE A SAND BLASTED FINISH FOR CONCRETE OVERLAY AND FLOAT FINISH FOR NO OVERLAY OR MEMBRANE AND ASPHALT OVERLAY.

THE CONCRETE IMMEDIATELY SURROUNDING ALL LIFTING DEVICES SHALL HAVE A FORMED RECESS 65mm DEEP. THE RECESS SHALL BE THOROUGHLY SANDBLASTED IN THE SHOP. AFTER ERECTION, THE LIFTING DEVICE SHALL BE BURNT OFF AT THE BOTTOM OF THE RECESS AND THE RECESS SHALL BE PATCHED WITH AN APPROVED NON-SHRINK GROUT.





PRESTRESSING STRAND LAYOUT

SCALE 1:10

## THIXOTROPIC EPOXY LAYOUT

	Rev	Date	Description		Init
RS					
сл.					
7	С	07-06-28	DESIGN CODE REVISIONS		W.H.K.
/	В	93-02-04	GENERAL		J.E.S.
<b></b>	Α	92-11-12	LIFTING DEVICE RECESS & NOTES		K.L.
	REVISIONS				
	BRITISH & Ministry of Transportation & Infrastructure				


STANDARD TWIN CELL CONCRETE BOX STRINGER MK. 600/12/E & MK. 600/12/I

Bridge Engineering

DESIGNED \_\_\_\_\_ IM \_\_\_\_ DATE \_\_\_\_\_\_O7-07-10 ORIGINAL SIGNED BY B. BARNEWALL CHECKED RM DATE 07-07-10
DRAWN WHK DATE 07-06-28 SENIOR BRIDGE DESIGN AND CONSTRUCTION STANDARDS ENGINEER SCALE AS NOTED 93/02/12 NEGATIVE No. FILE No.

CANCEL PRINTS BEARING PREVIOUS LETTER

2978-9

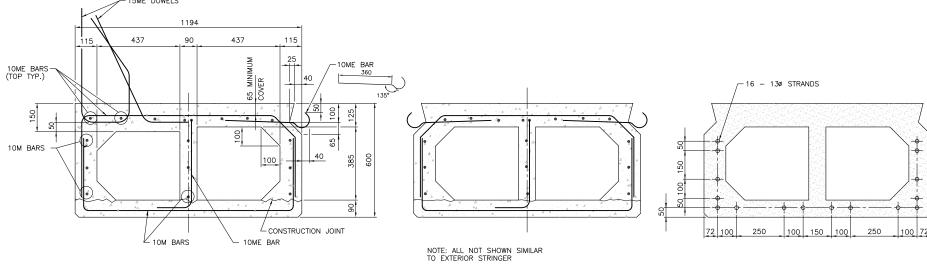

TYPICAL SECTION THROUGH

**EXTERIOR STRINGER** 

PICAL SECTION THROUGH INTERIOR STRINGER