



VALLEY TESTING & ENGINEERING

#18 - 3275 McCallum Road ph: 1-888-855-9733
 Abbotsford, B.C. V2S 7W8 fax: (604) 855-7378

SIEVE ANALYSIS REPORT 8 16 30 50 SERIES

TO
 Site ACTIVE EARTH ENGINEERING LTD
 4510 SADDLEHORN CRESCENT
 LANGLEY, BC
 V2Z 1J6

PROJECT NO. V8430
 CLIENT ACTIVE EARTH ENGINEERING LTD
 C.C.


ATTN: SEAN REILLY

PROJECT SIEVE TESTING
 AGGREGATE TESTING
 CONTRACTOR ACTIVE EARTH ENGINEERING

11932 TANNERY ROAD
 SURREY

SIEVE TEST NO. 1 DATE RECEIVED 2017.Mar.24 DATE TESTED 2017.Mar.27 DATE SAMPLED 2017.Mar.24

SUPPLIER AEE SAMPLED BY CLIENT
 SOURCE COMPOSITE FROM STOCKPILE TESTED BY CF
 SPECIFICATION TEST METHOD ASTM C-136
 MATERIAL TYPE SILTY SAND W/ GRAVEL (SAMPLE #1)

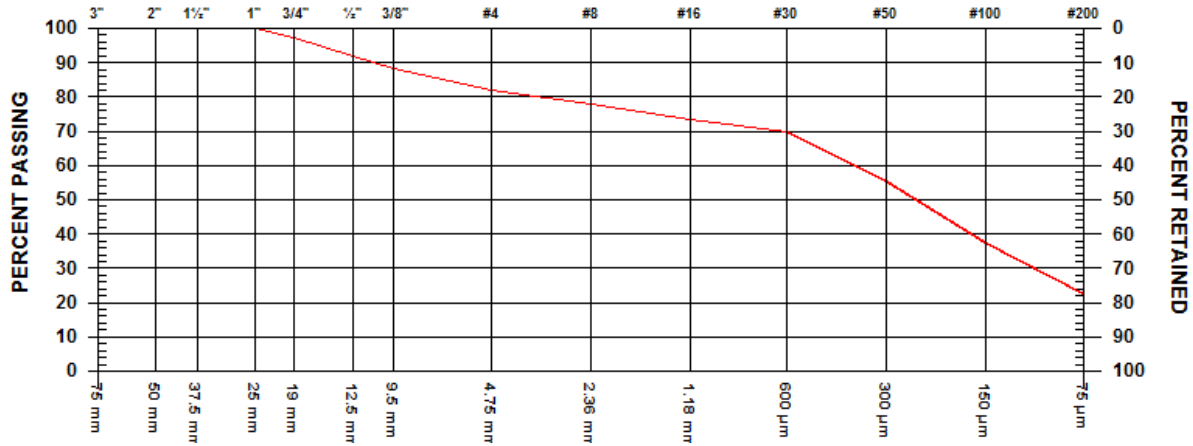

GRAVEL SIZES	PERCENT PASSING	GRADATION LIMITS	SAND SIZES AND FINES	PERCENT PASSING	GRADATION LIMITS
3" 75 mm			No. 4 4.75 mm	82.2	
2" 50 mm			No. 8 2.36 mm	77.8	
1 1/2" 37.5 mm			No. 16 1.18 mm	73.6	
1" 25 mm	100.0		No. 30 600 µm	69.8	
3/4" 19 mm	97.5		No. 50 300 µm	55.4	
1/2" 12.5 mm	91.9		No. 100 150 µm	37.2	
3/8" 9.5 mm	88.4		No. 200 75 µm	22.4	

COMMENTS
 SAMPLED ABOVE ELEVATION 9 BENCH NW SIDE

C/O SEAN REILLY (604-828-1441)

Page 1 of 1 2017.Mar.27 VALLEY TESTING & ENGINEERING PER.

Reporting of these test results constitutes a testing service only. Engineering interpretation or evaluation of test results is provided only on written request.

Report generated by: All tested materials will be stored for one week only.