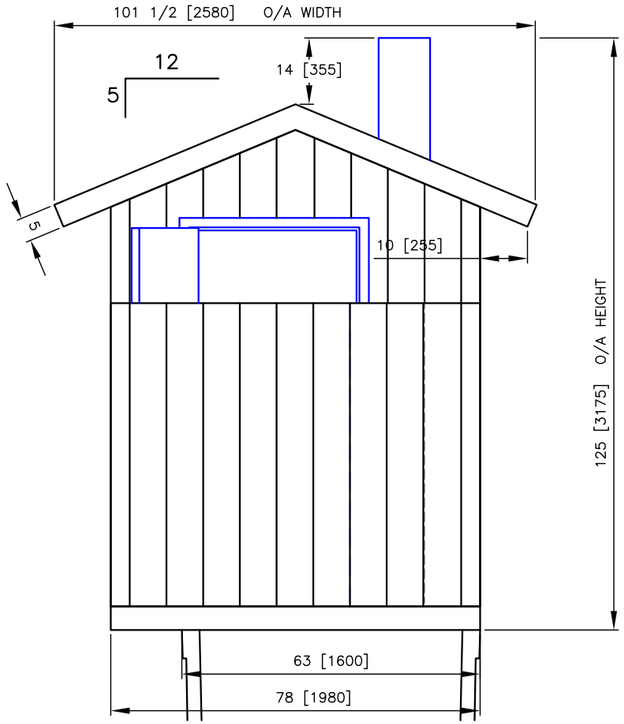

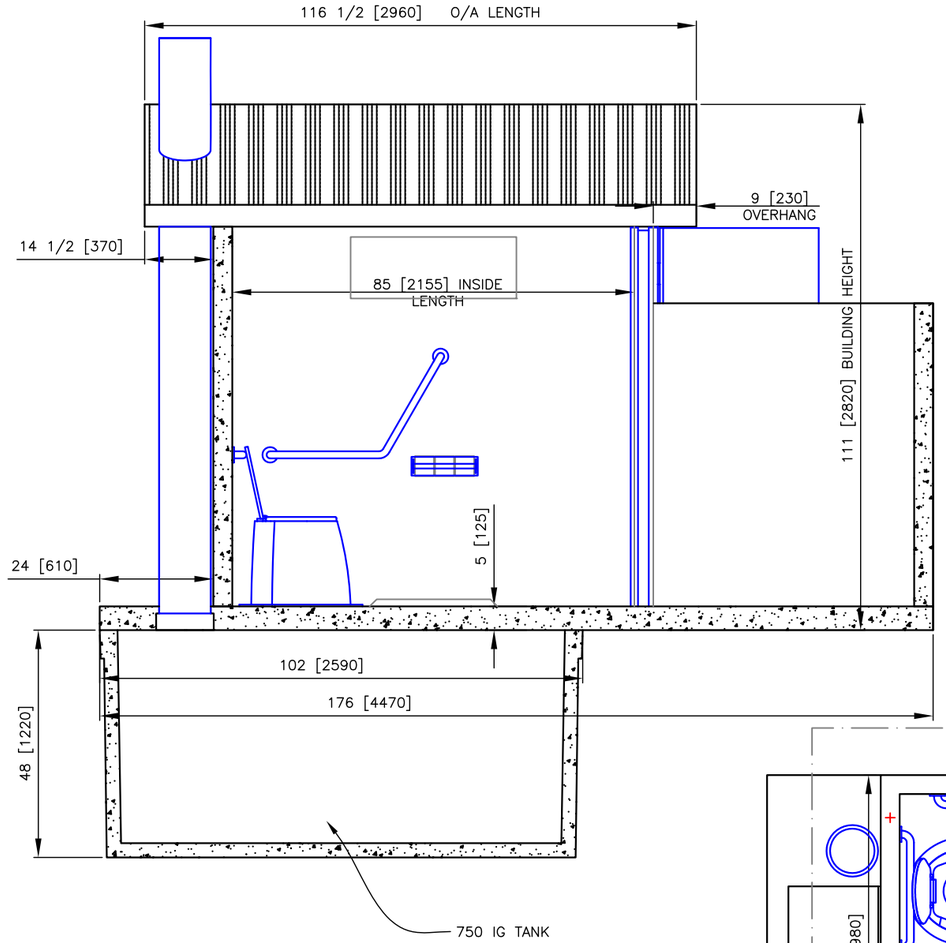

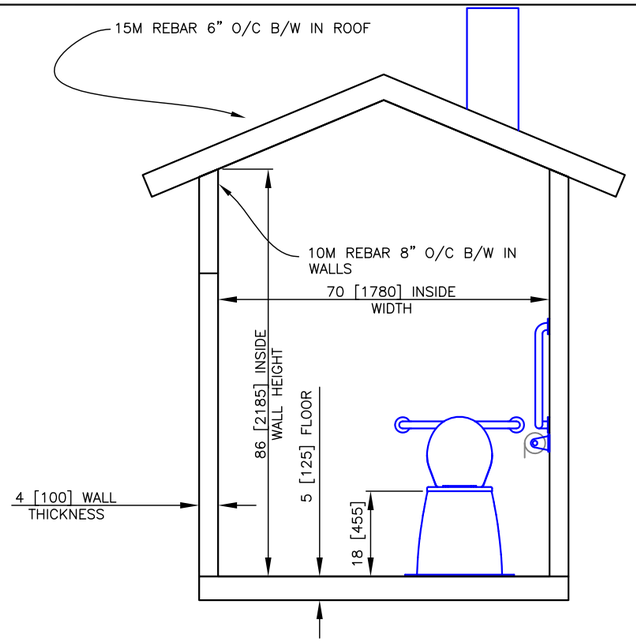

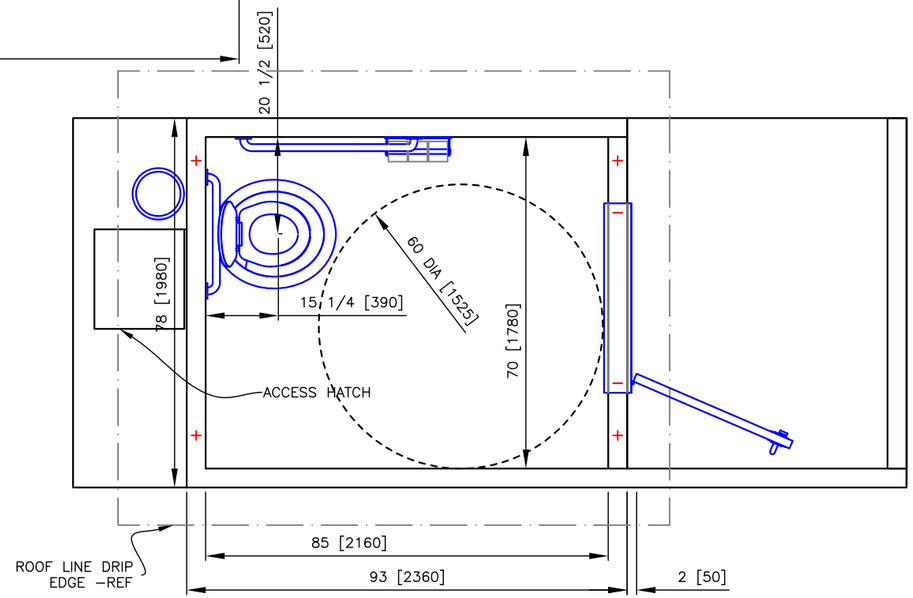

GENERAL NOTES

Concrete shall be exposure Class HSe and meet min compressive strength of 30MPA @ 28d

Air Category: 4.0% – 7.0%
Aggregate: CSA/CAN A23.4 Maximum Size: 20mm
Admixtures: CSA/CAN A23.4
Reinforcing: Grade 400W CSA G30.18–09
Inserts/Embeds: As noted in drawing details

Manufacture of precast concrete units shall be in accordance with specification CSA A23.4

** LEKO PRECAST LTD SHALL NOT BE RESPONSIBLE FOR ANY INSTALLATION PRACTICES FOLLOWED ON–SITE UNLESS PERFORMED BY LEKO PRECAST LTD **

Leko PRECAST LTD.

WOODY TOILET BUILDING, vestibule w/vault

DRAWN BY:	CHECKED BY:	APPROVED BY:	DATE:
JA			June 2016
ASSEMBLY DWG.	PREVIOUS DWG.	DRAWING NO.	REVISION
SCALE: 3/8"=1'–0" ISOMETRIC:		W2003	
DO NOT SCALE THIS DRAWING			